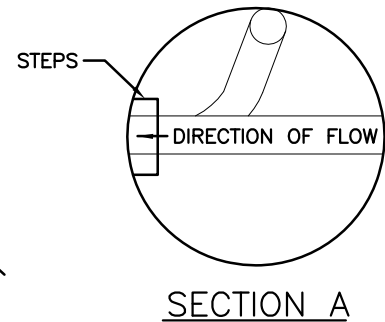
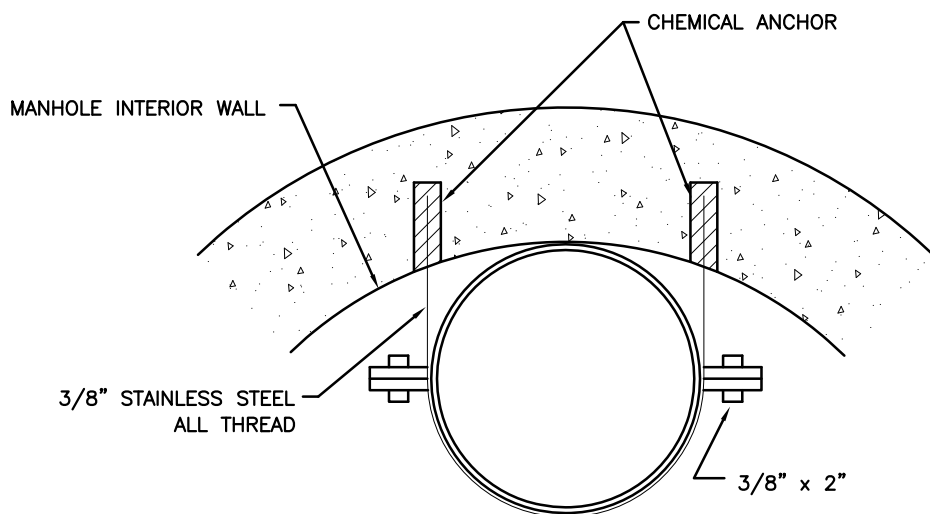
**NOTES:**

SEE ACWWA STANDARD
MANHOLE DETAILS FOR ALL
MANHOLE SPECIFICS INCLUDING
BASE DETAILS
SEE DETAIL SS-1

DROP PIPE SHALL MATCH SIZE
OF INFLUENT LINE OR 6" MIN

**BRACKET DETAIL**

MANUFACTURE BRACKET FROM 3/8" STAINLESS STEEL.

NOTES:

MANHOLE SIZE VARIES WITH SIZE OF THE MAINLINE.

8" - 10" MAINLINE = 5' DIA. MANHOLE

12" - 15" MAINLINE = 6' DIA. MANHOLE

7' DIA. MANHOLE FOR LARGER MAINLINES.

STEPS INSTALLED OVER DOWNSTREAM INVERT OF MANHOLE.

ARAPAHOE COUNTY
Water and Wastewater Authority

13031 E Caley Ave, Centennial, Colorado 80111
Ph: (303) 790-4830 Fax: (303) 790-1718
© Copyright 2007 All Rights Reserved

**INSIDE DROP MANHOLE
CONSTRUCTION DETAIL**

REVISION DATE:
03/01/2013

FIGURE NO.

SS-4

SHEET NO.

1 of 1