


Drawing for information ONLY. Prior to any construction, a scaled mechanical drawing is to be submitted for approval to ACWWA. Drawing shall include: piping arrangements, meter and backflow location, drain location and size, dimensions above floor and from walls and other pertinent information.

USC approved, (BFP) reduced pressure principle backflow preventer with air gap drain (includes gate valves)

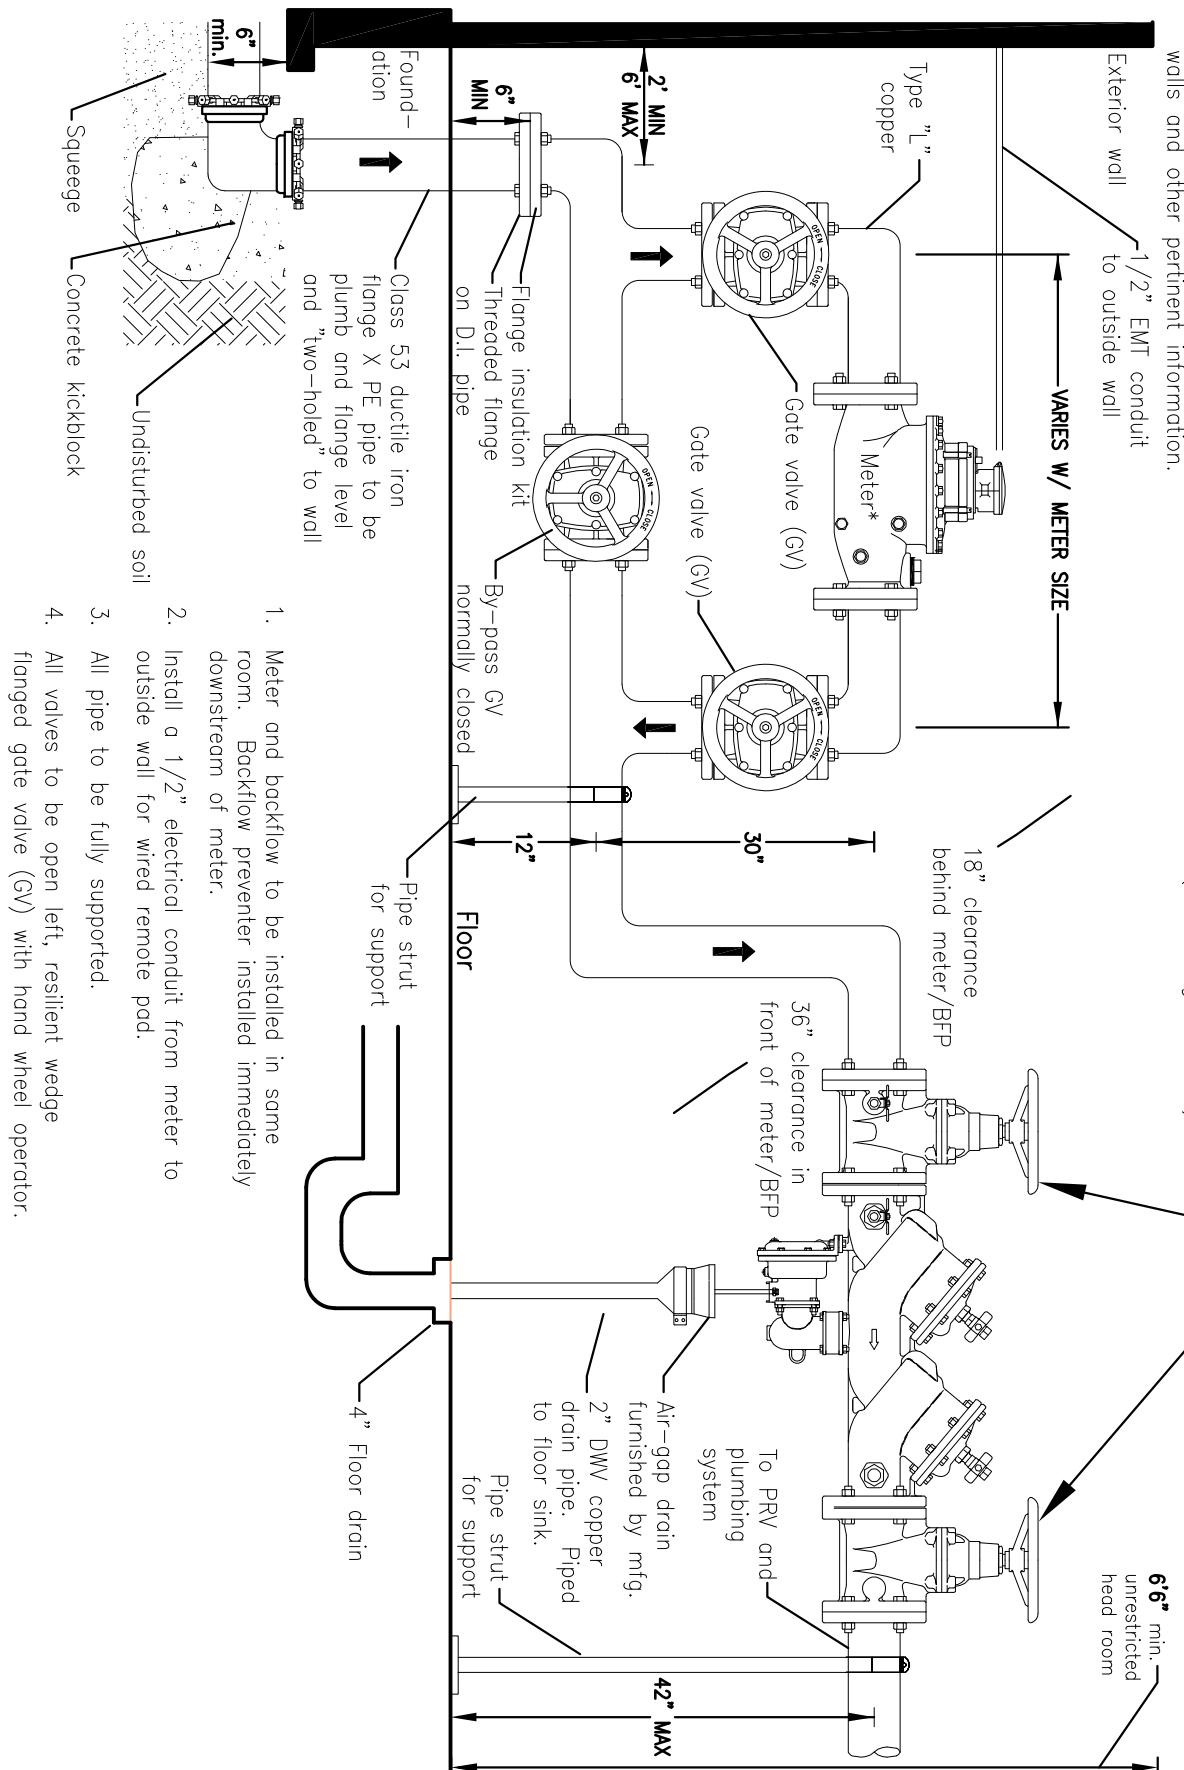

*Meter supplied by ACWWA

ARAPAHOE COUNTY
Water and Wastewater Authority

13031 E Caley Ave, Centennial, Colorado 80111
Ph: (303) 790-4830 Fax: (303) 790-1718
© Copyright 2007 All Rights Reserved

3" INSIDE METER SETTING

REVISION DATE:
03/01/2013
FIGURE NO.
W-29
SHEET NO.
1 of 1